

C Series
Single Channel
Potentiometer Transmitter



→ Introductions

This potentiometer transmitter converts the 3-wire potentiometer signals to current or voltage signals. DIN rail power supply function can be selected in ordering.

The input, output, and power supply are galvanically isolated from each other. You can use handheld programmer to modify parameters or to calibrate the apparatus.

→ Parameters

Power supply:

Connection type: Terminals (9+, 10-) or DIN rail connector

Rated voltage: 18 V DC ~ 60 V DC (Recommended voltage: 24 V DC)

Input (1, 2, 3):

3-wire potentiometer: 0 Ω ~ 10 kΩ

Output (5, 6; 7, 8):

Output current: 0(4) ~ 20 mA; 0 ~ 10 mA

Output voltage: 0(1) ~ 5 V; 0 ~ 10 V

Load resistance:

0(4) ~ 20 mA: ≤ 550 Ω; 0 ~ 10 mA: ≤ 1.1 kΩ

0(1) ~ 5 V: ≥ 1 MΩ; 0 ~ 10 V: ≥ 2 MΩ

Transmission characteristics:

Accuracy: ± 0.1% F.S. (25 °C ± 2 °C)

Response time: ≤ 0.5 s

Temperature drift: 30 ppm/°C

Electromagnetic compatibility: Accordance to IEC 61326-3-1

Dielectric strength (1 mA leakage current, 1 minute test time):

≥ 1500 V AC (Input /Output/Power supply)

Ambient conditions:

Operation temperature: -20 °C ~ +60 °C

Relative humidity: 10% RH ~ 90% RH (40 °C)

Atmosphere pressure: 80 kPa ~ 106 kPa


Storage temperature: -40 °C ~ +80 °C

Power dissipation:

0.8 W (24 V DC, single output)

1.2 W (24 V DC, double output)



→ Model rules

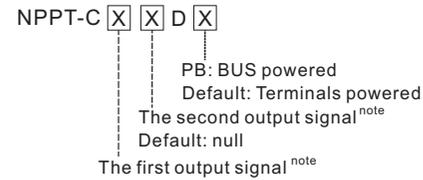

NOTE : Output signal

Number	Output signal
1	4 mA ~ 20 mA
2	1 V ~ 5 V
3	0 mA ~ 10 mA
4	0 V ~ 5 V
5	0 V ~ 10 V
6	0 mA ~ 20 mA
X	User customized signal type


→ Wiring diagram

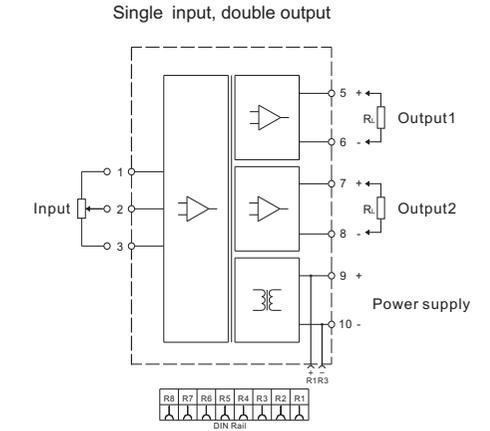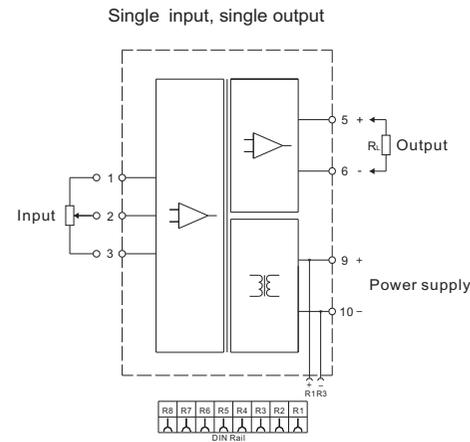

- Follow mode: Whatever input fault status (except breakage), the output follows the input within measuring range. And the maximum value would not exceed the 110% of the upper limit of the measuring range (e.g. When the output signal type is 0 ~ 20 mA, the minimum output value may be 0 mA, the maximum output value would not exceed 22 mA).
- DIN rail power supply function is selectable at ordering.

→ Dimension

Width × Height × Depth: 12.8 mm × 110 mm × 117 mm

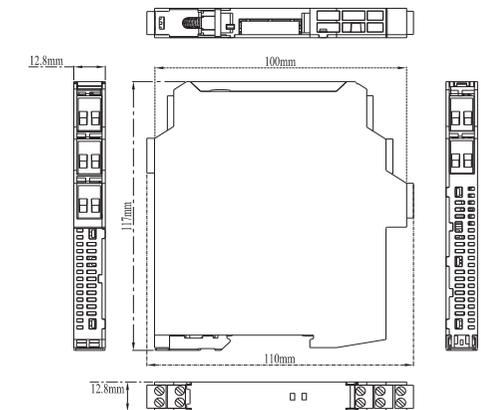


Nanjing New Power Electric Co., Ltd.

→ BUS Specification


BUS	Electrical Characteristics
Current	Max. 8 A
Voltage (UL/IEC)	1.6 kV
Operation temperature	-40 °C ~ +105 °C

→ Installation


- The apparatus can be installed on the DIN 35 mm standard rail which is corresponding to DIN IEC 60715. The must be snapped onto the rail, and never slanted or tipped to the side.
- Installation and disassembly steps are shown in following figures:




A. Snap the BUS socket on the DIN 35 rail, as figure A;

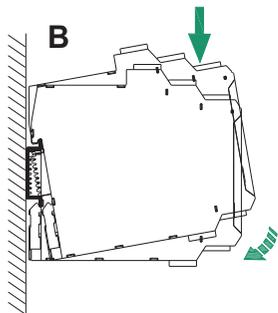

B. Snap metal lock onto mounting rail, then rotate the apparatus, as figure B, press down the apparatus onto mounting rail, make sure that the BUS connector pins of apparatus and BUS socket are in close contact.

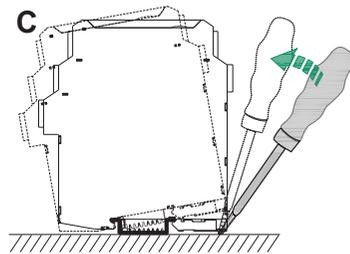


C. Pry the metal lock off the rail with screwdriver as arrow shown, pull downward the springs, and rotate the apparatus.



D. Remove the apparatus as arrow shows.

- As far as possible to mount it vertically, In order to dissipation the heat of the apparatus

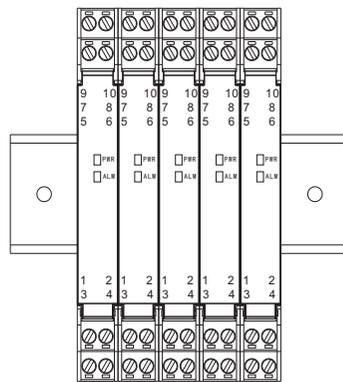

Vertically installation

→ Light indication

- **PWR:** Power indicator light shows green, it means work normally.
- **ALM:** Input signal state indicator (red), it is off during normal operation, remain bright when input over-range. It is glitter when input line breakage.

→ Attention

- The devices degree of protection is IP 20 and must be protected from undesirable ambient conditions (waterproofing, small foreign objects). It is suitable for installation in the control room or high density field cabinet, DIN 35 mm installation is convenient for installation and displacement.
- The devices were designed for use in pollution degree 2 and overvoltage category III as per IEC/EN 60664-1. If used in areas with higher pollution degree, the devices need to be protected accordingly.
- Installation position shall not be affected by strong mechanical vibration; impact and electromagnetic induction from signal terminal and power supply, should conformity with the requirements on electromagnetic interference resistance of products in Class 3 industrial field atmosphere stipulated in IEC 61000-4; the atmosphere shall be free from gases that are corrosive to metal and plastic components.
- The apparatus must be installed, connected and adjusted by qualified personnel in non-hazardous area according with the instruction manual.
- The operator must strictly comply with the relevant local safety standards and guidelines.

→ Supplementary instructions

- Our company reserves the right to change the product information without prior notification to the user. If the contents of the description are different from website or sample, this description shall prevail.